

CITY OF BALTIMORE WET WEATHER CONSENT DECREE SMOKE AND  
DYED WATER TESTING FORM

Page 1 of 3

Sewershed: Dundalk

Consultant: RJN Group, Inc.

Date: YYYYMMDD  
2008 / 09 / 15

Test to be performed:  
Smoke ☒ Dye ☐

Ground Condition:  
☒ Dry ☐ Damp ☐ Wet


Supervisor initials: TS

Manhole ID: S650-018MH

Test ID: 1047- 173

Notifications - made daily: ☒  
(Residents, Fire, 311)

Field Sketch: Show all manholes with numbers, blower placement location, sandbag or isolation device location, street names, building addresses and locations, defect locations and photograph numbers

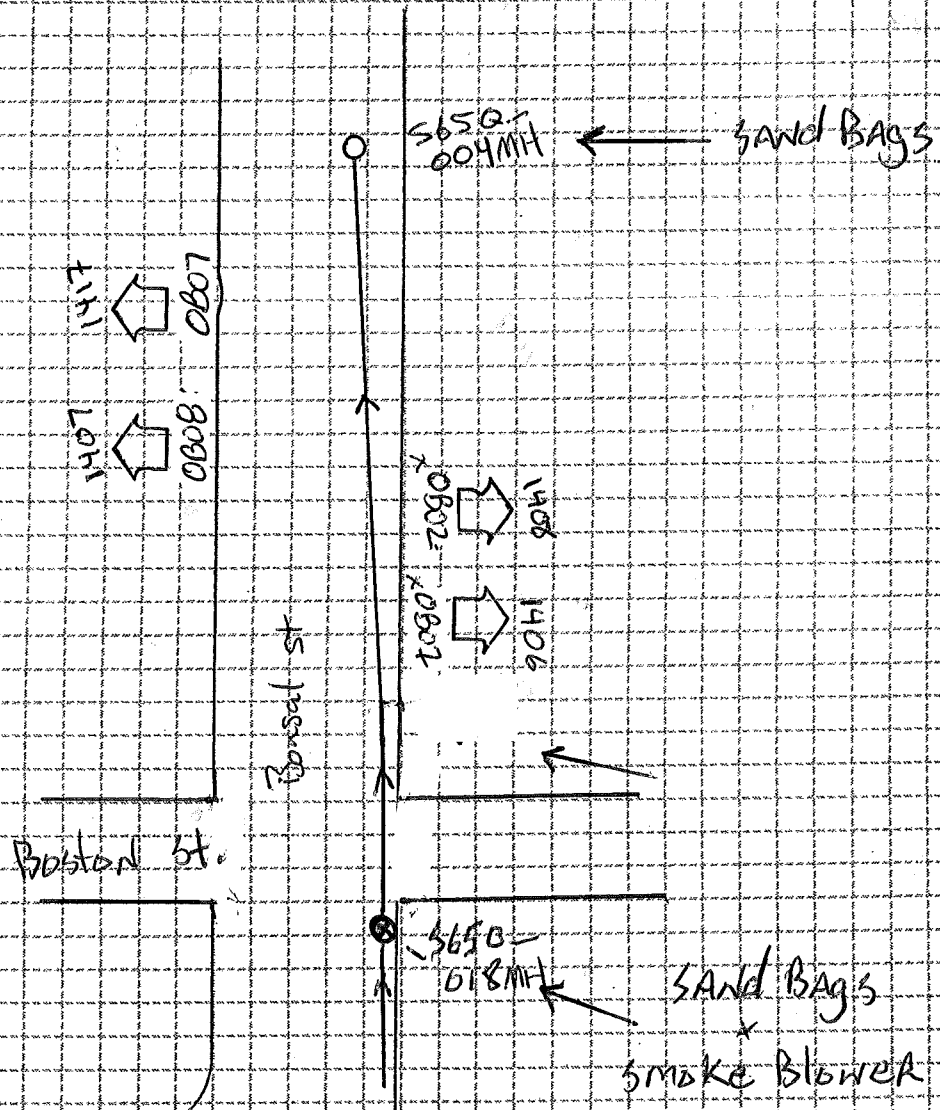

**rjn**group

CITY OF BALTIMORE WET WEATHER CONSENT DECREE SMOKE AND  
DYED WATER TESTING FORM

Page 2 of 3

Sewershed: Dundalk

Consultant: RJN Group, Inc.

Date: YYYYMMDD

2008/09/15

Test to be performed:  
Smoke ☒ Dye ☐

Ground Condition:  
☒ Dry ☐ Damp ☐ Wet

Supervisor initials: JS

Manhole ID: S65Q004 MH

Test ID: 1047- 173

Notifications - made daily: ☒  
(Residents, Fire, 311)

Field Sketch: Show all manholes with numbers, blower placement location, sandbag or isolation device location, street names, building addresses and locations, defect locations and photograph numbers.

Bonsal St

S65Q004 MH

0806 1425

0805 1428

0804 1421

0803 1438

S65Q003 MH

SMOKE BLOWER + SAND BAGS

SMOKE BLOWER + plug

rjngroup

CITY OF BALTIMORE WET WEATHER CONSENT DECREE SMOKE AND  
DYED WATER TESTING FORM

Page 1 of 3

Sewershed: Dundalk

Consultant: RJN Group, Inc.

Date: YYYYMMDD  
2008 / 09 / 15

Test to be performed:  
Smoke ☒ Dye ☐

Ground Condition:  
☒ Dry ☐ Damp ☐ Wet

Supervisor initials: TS

Manhole ID: 5650-018MH

Test ID: 1047- 173

Notifications - made daily: ☒  
(Residents, Fire, 311)



1047-173-OB01-P01 Private Cleanout,  
medium smoke, grass.



1047-173-OB02-P01 Private Cleanout,  
medium smoke, grass.



1047-173-OB07-P01 Private Cleanout, light  
smoke, grass.



1047-173-OB08-P01 Private Cleanout,  
medium smoke, grass.



CITY OF BALTIMORE WET WEATHER CONSENT DECREE SMOKE AND  
DYED WATER TESTING FORM

Page 2 of 3

Sewershed: Dundalk

Consultant: RJN Group, Inc.

Date: YYYYMMDD

2008/09/15

Test to be performed:  
Smoke ☒ Dye ☐

Ground Condition:  
☒ Dry ☐ Damp ☐ Wet

Supervisor initials: JS

Manhole ID: S65Q004 MH

Test ID: 1047-173

Notifications - made daily: ☒  
(Residents, Fire, 311)



1047-173-OB03-P01 Private Cleanout, light  
smoke, grass.



1047-173-OB04-P01 Private Cleanout, light  
smoke, grass.



1047-173-OB05-P01 Private Cleanout, light  
smoke, grass.



1047-173-OB06-P01 Private Cleanout, light  
smoke, grass.